


# TYPICAL STRUCTURE FOR TEMPORARY OVERHEAD SERVICE

\* SERVICE DROP  
MINIMUM CLEARANCES

- 12 FT. - ABOVE SIDEWALKS
- 15 FT. - ABOVE RESIDENTIAL DRIVEWAYS
- 18 FT. - ABOVE PUBLIC DRIVEWAYS AND ROADS.

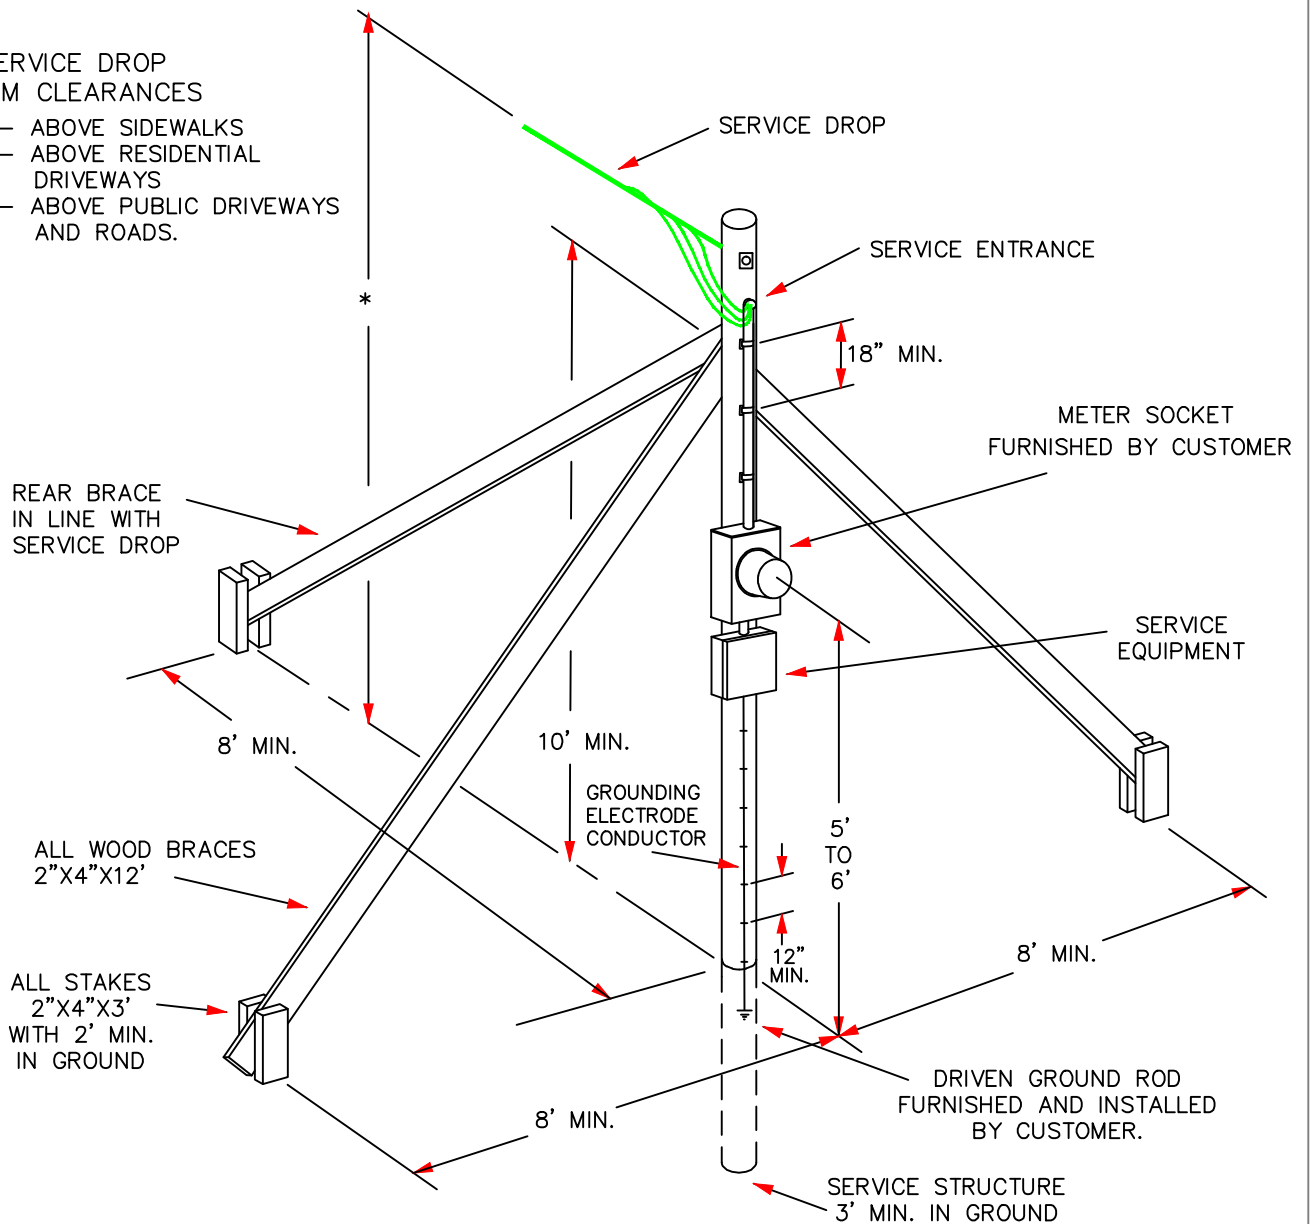

CUSTOMER SHALL FURNISH, INSTALL AND MAINTAIN:

- A. TREATED WOOD SERVICE STRUCTURE RATED FOR IN GROUND USE WITH BRACES AND STAKES TO BE SOUND. (MIN. 4" X 4" OR 6" DIA. POST)
- B. SERVICE ENTRANCE CABLE AND CONDUIT TO BE INSTALLED ACCORDING TO NEC.
- C. SERVICE EQUIPMENT TO INCLUDE GFCI RECEPTACLES.
- D. GROUND ROD ACCORDING TO NEC. (NO. 6 MINIMUM COPPER GROUNDING CONDUCTOR)



## CITY OF COVINGTON

NEWTON COUNTY, GEORGIA

DATE: JANUARY 1, 2016

©2016  
CITY OF COVINGTON  
ALL RIGHTS RESERVED