


TRANSFORMER CLEARANCE FROM BUILDINGS


Specification UMI-7

TRANSFORMER PADS SHALL NOT BE LOCATED IN SHADED AREA.

PREFERRED BUILDING SIDE



THIS SIDE SHALL BE OPEN AND ACCESSIBLE

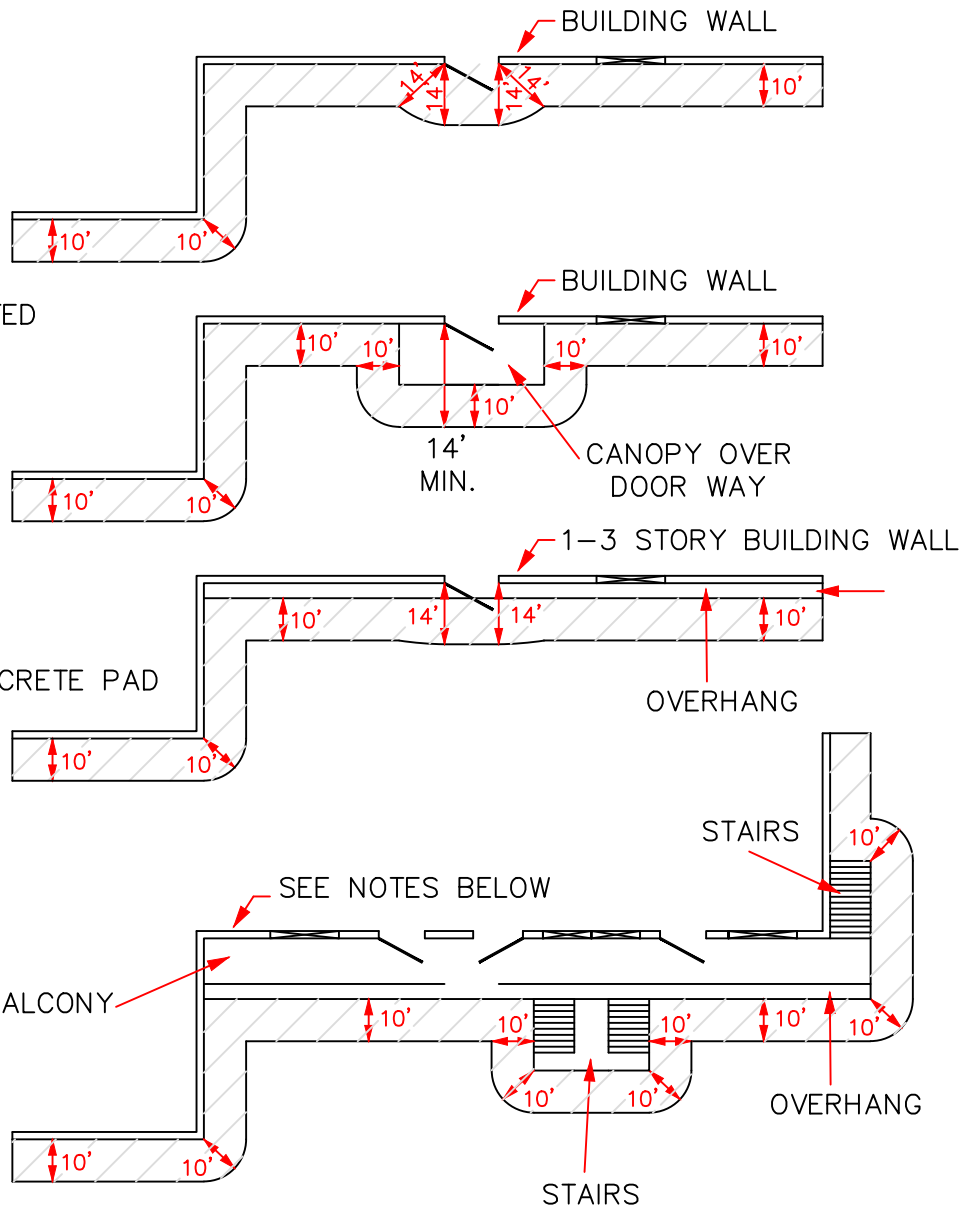

NOTES:

1. THE STANDARD PAD LOCATION SHALL BE 10 FEET FROM THE BUILDING WALL.
2. EDGE OF PAD SHALL BE NO LESS THAN 14 FEET FROM DOORWAY.
3. EDGE OF PAD SHALL BE NO LESS THAN 10 FEET FROM WINDOWS OR OTHER OPENINGS.
4. IF THE BUILDING HAS AN OVERHANG AND IS 3 OR LESS FLOORS IN HEIGHT ABOVE THE GROUND, THE 10 FEET CLEARANCE IS MEASURED FROM A POINT BELOW THE EDGE OF THE OVERHANG.
5. IF THE BUILDING HAS AN OVERHANG AND IS 4 OR MORE FLOORS IN HEIGHT ABOVE THE GROUND, THE 10 FEET CLEARANCE MAY BE MEASURED FROM THE BUILDING WALL.
6. FIRE ESCAPES, OUTSIDE STAIRS, AND COVERED WALK WAYS ATTACHED TO OR BETWEEN BUILDINGS SHALL BE CONSIDERED AS PART OF THE BUILDING.
7. ALWAYS MAINTAIN 10 FEET OF CLEARANCE IN FRONT OF THE PAD.



CITY OF COVINGTON
NEWTON COUNTY, GEORGIA

DATE: April 3, 2017 REVISED: April 3, 2017

© 2016 CITY OF COVINGTON ALL RIGHTS RESERVED